

# Mean Electric Costs, Energy Costs, and kWh/1,000 Gallons Consumed at Iowa Surveyed Activated Sludge/Trickling Filters Wastewater Treatment Systems

Figure WW4-1. Mean 1999 - 2000 electric costs for surveyed Iowa wastewater treatment systems with activated sludge & trickling filter.

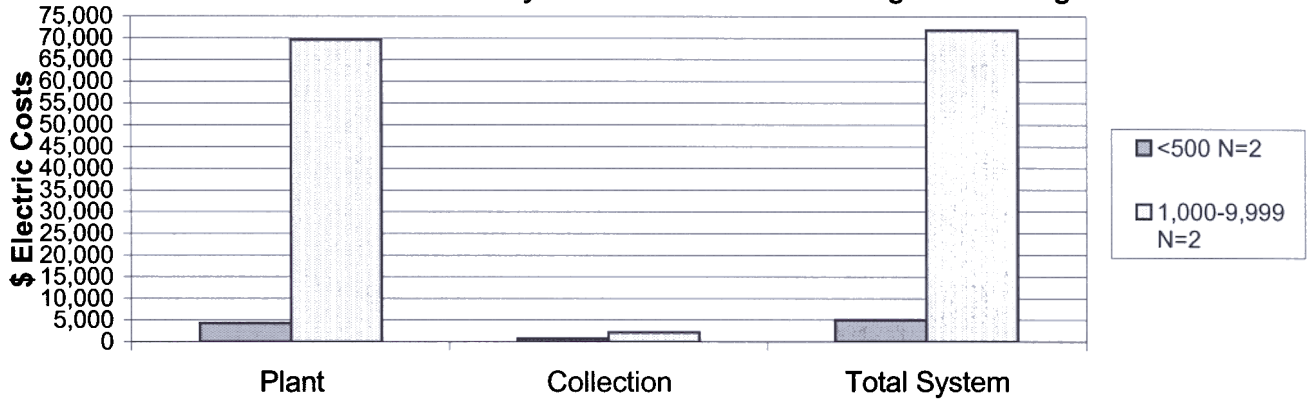


Figure WW4-2. Mean 1999 - 2000 energy costs for surveyed Iowa wastewater treatment systems with activated sludge & trickling filter.

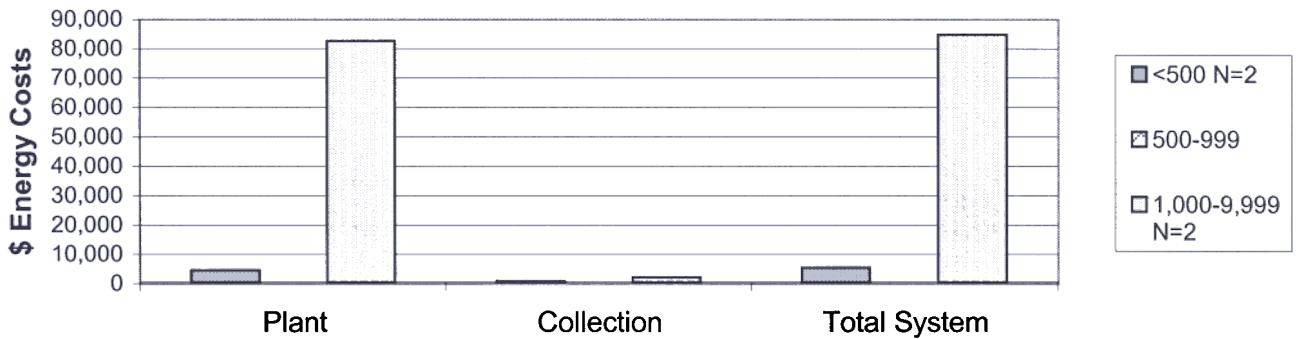


Figure WW4-3. Mean 1999 - 2000 kilowatt-hr/1000 gal consumed to treat surveyed Iowa wastewater treatment systems with activated sludge & trickling filter.

