

Mean Electric Costs, Energy Costs, and kWh/1,000 Gallons Consumed at Iowa Surveyed Nonaerated Facultative Lagoon Treatment Systems

Figure WW6-1. Mean 1999 - 2000 electric costs for surveyed Iowa wastewater treatment systems with nonaerated facultative lagoon.

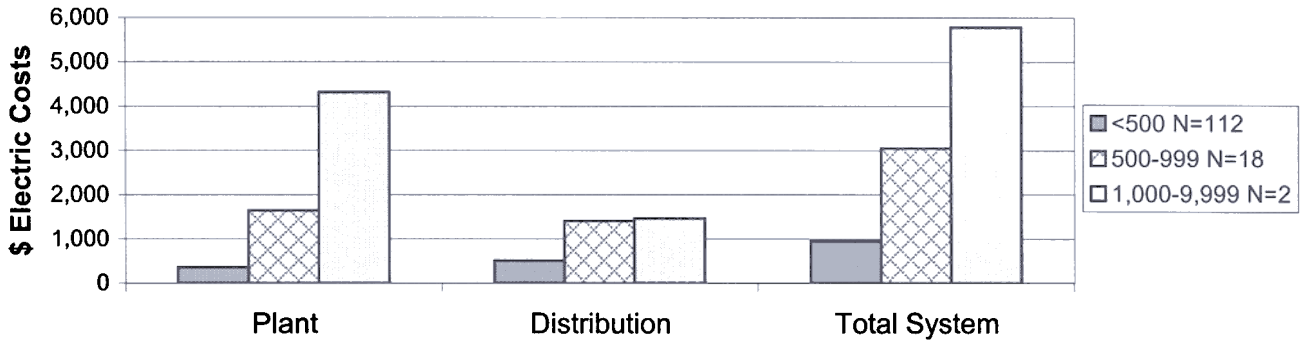


Figure WW6-2. Mean 1999 - 2000 energy costs for surveyed Iowa wastewater treatment systems with nonaerated facultative lagoon.

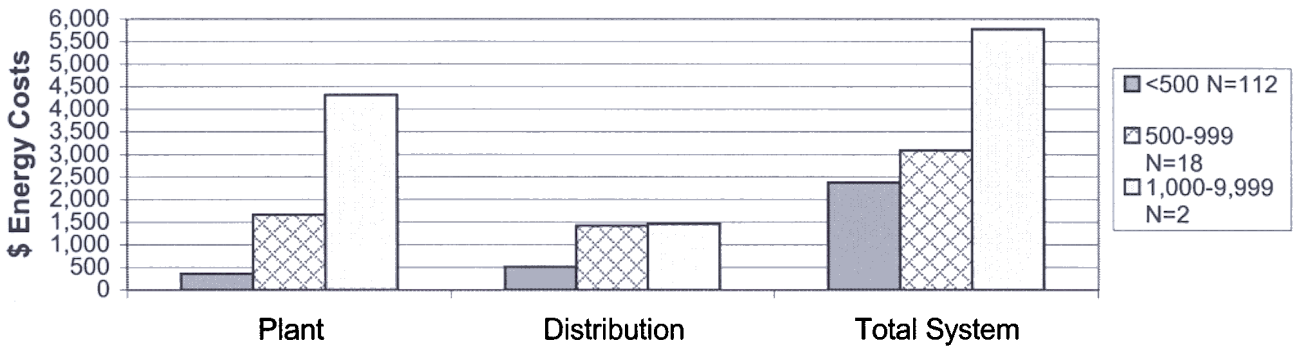


Figure WW6-3. Mean 1999 - 2000 kilowatt-hr/1,000 gal consumed to treat surveyed Iowa wastewater treatment systems with nonaerated facultative lagoon.

